


WATER TANK NOTES

- NO BUILDING PERMIT IS REQUIRED FOR WATER TANKS SUPPORTED DIRECTLY ON GRADE IF IT IS LESS THAN 5,000 GALLONS AND THE RATIO OF HEIGHT TO DIAMETER OR WIDTH DOES NOT EXCEED 2:1. FOR TANKS THAT DO NOT MEET THE ABOVE A BUILDING PERMIT AND CONCRETE FOUNDATION IS REQUIRED.

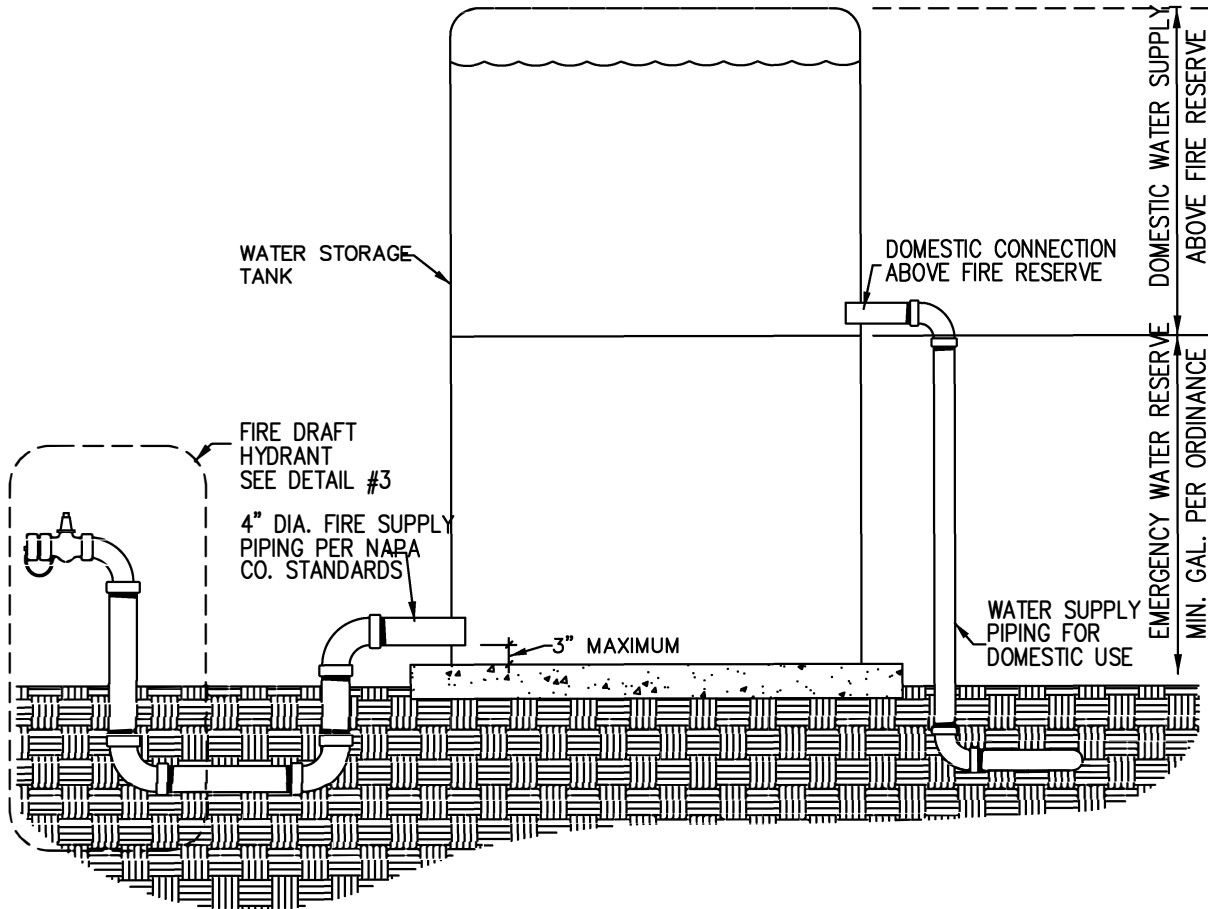

WATER STORAGE TANK

WATER SUPPLY NOTES

- FOR WATER TANK STORAGE CAPACITY REQUIREMENTS REFER TO LAKE COUNTY AMENDMENTS TO C.F.C. 2016
- WHEN MULTIPLE WATER TANKS ARE UTILIZED TO ACHIEVE THE REQUIRED VOLUME OF WATER, THE CONNECTION BETWEEN THE TANKS SHALL BE BY AN APPROVED 4" DIA. WATER LINE.

| | | |
|--------------------------------------|---------------------|----------|
| RESIDENTIAL WATER SUPPLY FROM TANK | FIRE SAFE STANDARDS | |
| Lake County Fire Protection District | DATE: FEBRUARY 2016 | |
| | REVISED: 01/2018 | |
| | APPROVED | 4 |